

Diesel Generator Katolight - MTU 125 KW

Currently this unit is set up for 480 volt three phase but it is re-connectable to single phase. It is also re-connectable to 120/280 volt three phase, and 120/240 volt three phase This unit is rated at 125 KW three phase and 100 KW connected for single phase.

Engine Model: John Deere 4045HF285,

RATINGS -

THREE PHASE	SINGLE PHASE
KW: 125,	KW: 100
KVA: 156,	KVA: 100
P.F.: .80,	P.F.: 1.0

Current Connection Voltage: 480 Volt 3 Phase 12w 60Hz,
Temperature Rise: 130 Deg,
Specifications/Listings: UL2200,
Cooling System: 50 Deg C Cooling System ,

CONTROL PANEL

Control Panel: DGC 2020 Control Panel,
Control Panel Unit Mounted LH Side,
Level 1 Expanded Outputs

CIRCUIT BREAKER

Circuit Breaker: 225 Amp J Frame 3 Pole 80% Standard CB,
Circuit Breaker Factory Installed RH Side,
All breaker accessories are wired to a terminal strip for customer connection.

OTHER COMPONENTS

Jacket Water Heater: -20 Deg F Block Heater (120V - 1500W),
Jacket Water Heater Mounted & Wired,
Jacket Water Heater Isolation Valves (2),
Air Filter: Standard Duty,
Battery Configuration: Battery; Rack & Acid,
Battery Charger: NRG 22-10-HCLS,
Charger Mounted and DC Wired,

PAINT

Paint Color 61 Gray (Standard),

HOUSING


Housing Option: Level 1 Enclosure - Standard,
Enclosure Type: Level 1 - Steel,
- Wind Rating 100 MPH Standard
Exhaust Grade: Hospital Grade Silencer (Standard),

FUEL TANK

Sub-Base Fuel Tank
Fuel Tank: 24 Hr/240 Gallon Fuel Tank W Stub-Up,
- Fuel Leak Detection Float Switch (Standard),
- Emergency Pressure Relief Vent Cap (Standard),

MISC

Vibration Isolators: Pad Isolators (Standard),
Shipping Instructions: Ship Unit Wet (Fluids Installed - oil and anti-freeze),

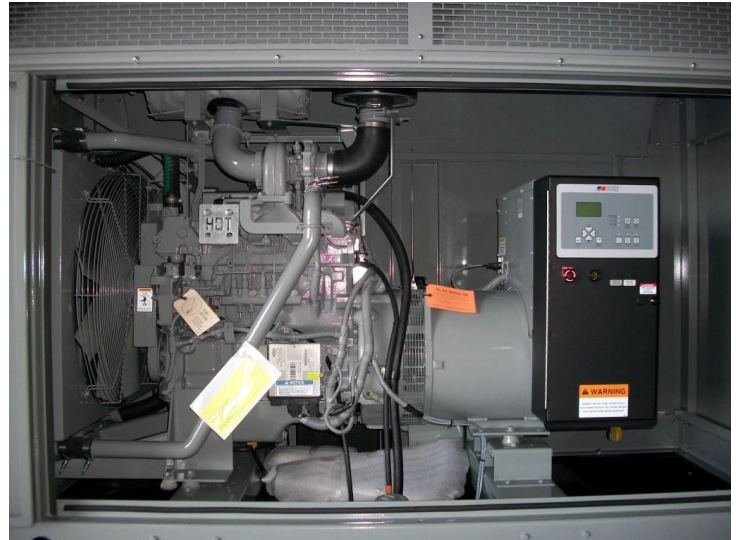

Hamilton Distributing Company

Phone: 1-800-248-8070

Website: www.Hamiltondist.com

3392 M-40 South

Hamilton, MI 49419

**Warranty Selected: 2 Yr/3000 Hr Basic Stdbly Limited Warranty (Std),
Factory Prot-type test unit - Only 39 Minutes run time on the hour meter!**